



—

.....	5
.....	5
.....	6
.....	6
.....	7
.....	15
.....	15

DL/T963-2005

,

1.

2.

3.

,

,

4.

5.

6.

(120 °)

7.

.

.Z

.

PT.CT

8.

:

9.

10.

11. 800×480 ,

12. 1000 U

13. word

14. AC380V

1. : 1 10000

2. : 1 12

3. 0° 360°

4. : 1 999.9 :0.2

1000 10000 :0.5


5. : 0.0001

6. : 0.01°

7. : $220V \pm 10\%$ $50Hz \pm 1Hz$

8. -10 40 <85%RH

:

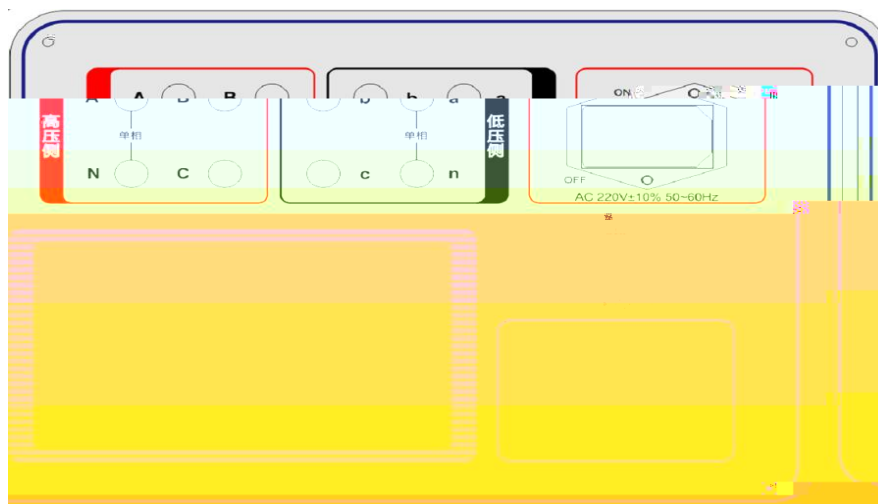

1

A-----A
B-----
C-----
N-----X
a-----a
b-----
c-----
n-----x

PT

PT

A-----A
B-----
C-----
N-----X
a-----a
b-----
c-----
n-----x

A-----A
B-----B
C-----C
N-----
a-----a
b-----b
c-----c
n-----

CT


CT

A-----1S1
B-----
C-----
N-----2S2
a-----P1
b-----
c-----
n-----P2


A B C

,

2. ,

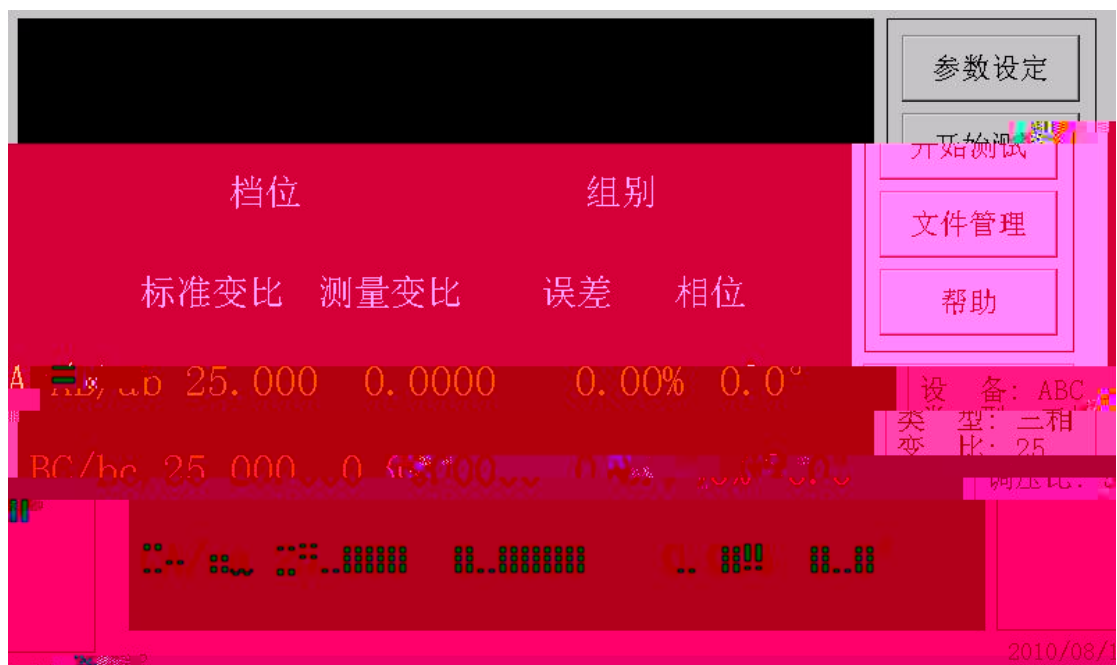

2

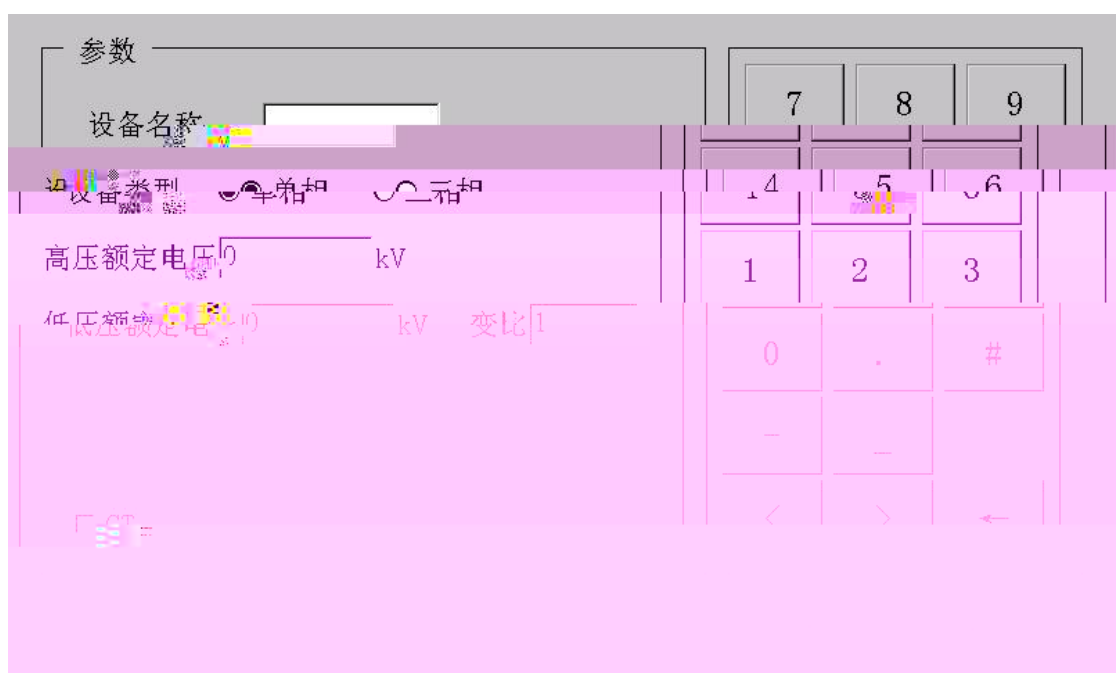

3

参数

设备名称

设备类型

☐ 单相

☒ 三相

高压额定电压

10

kV

低压额定电压

0.4

kV

变比

25

档位电压差

0500

V

调压比

5

%

开关分接范围

3

额定档位

2

7

8

9

4

5

6

1

2

3

0

.

#

-

-

<

>

←

默认值

确定

取消

4

(A B C

D...) <>

←

. PT .CT.


Z . .

KV


0.XXXKV,

9

3

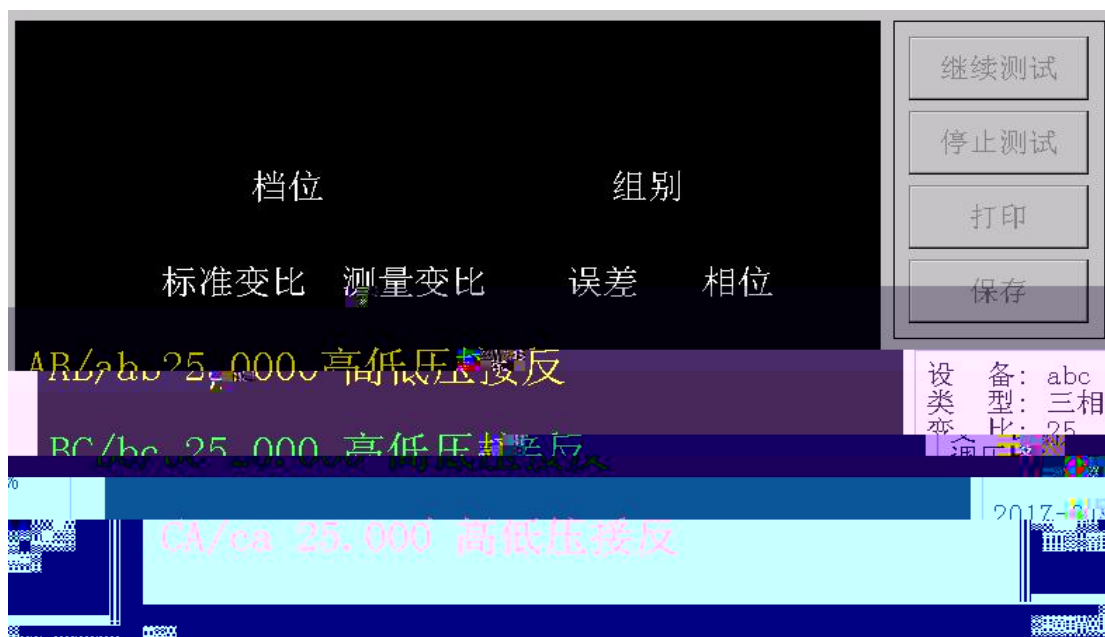

5

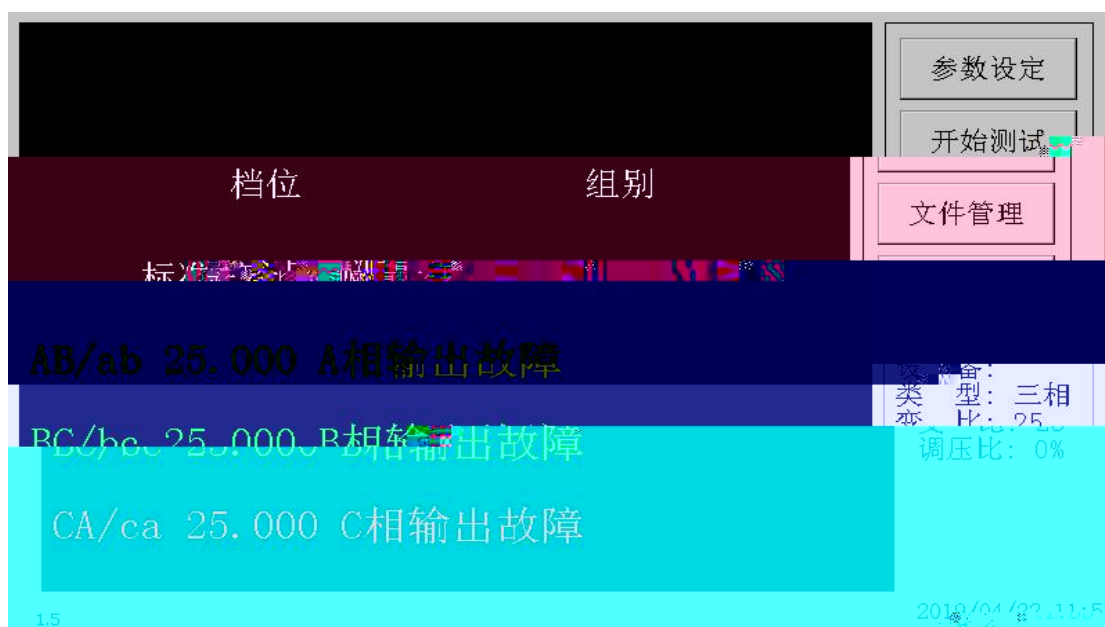


6



7


word

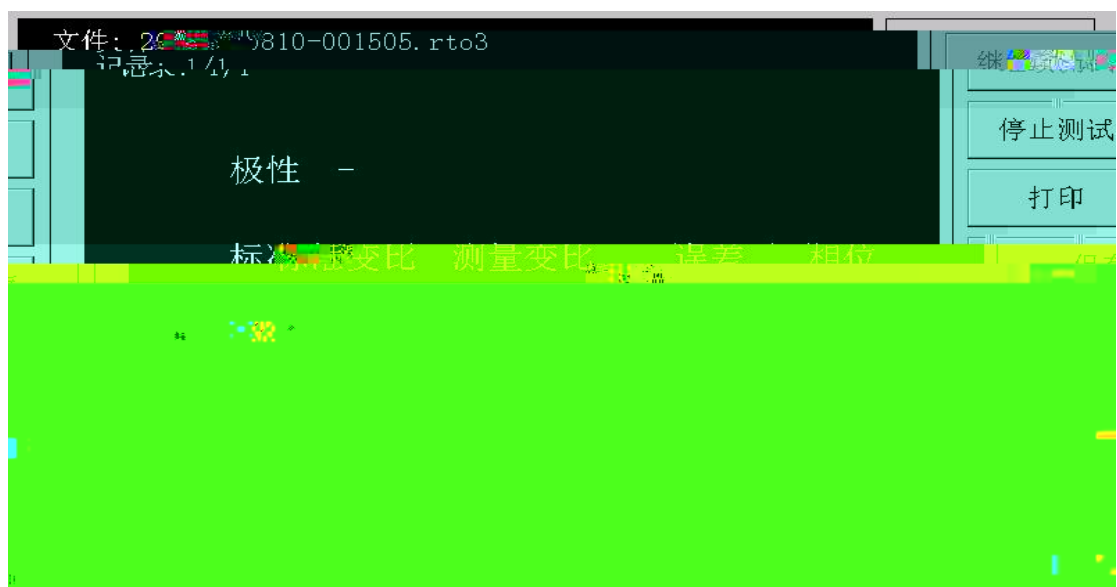

8

+

word

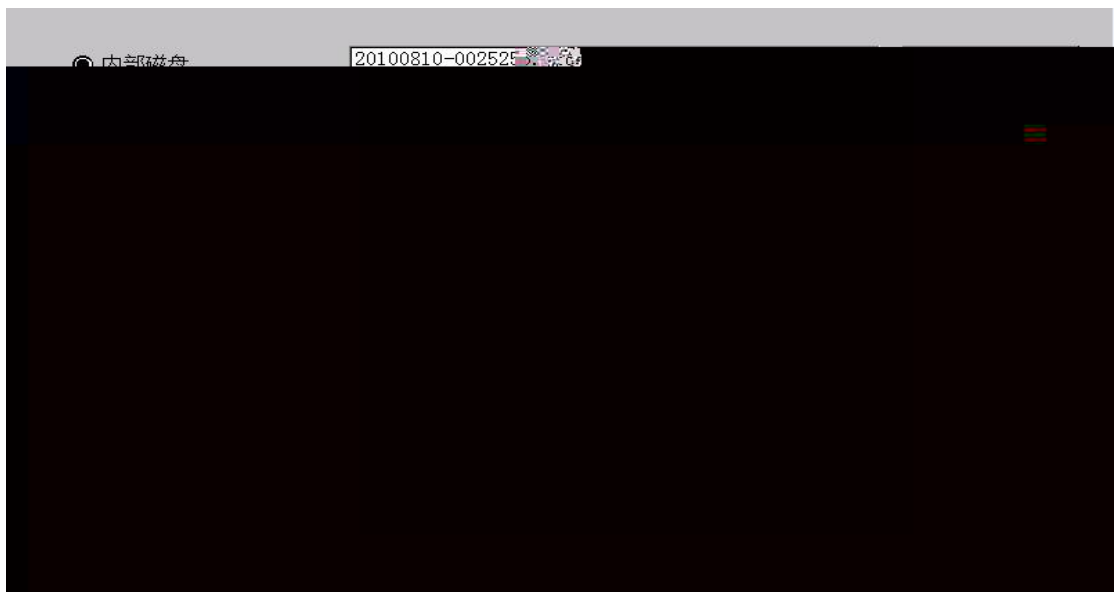

9

U

20100810-001816 ABC.rto3

ABC

U



U


U

.

1000

U

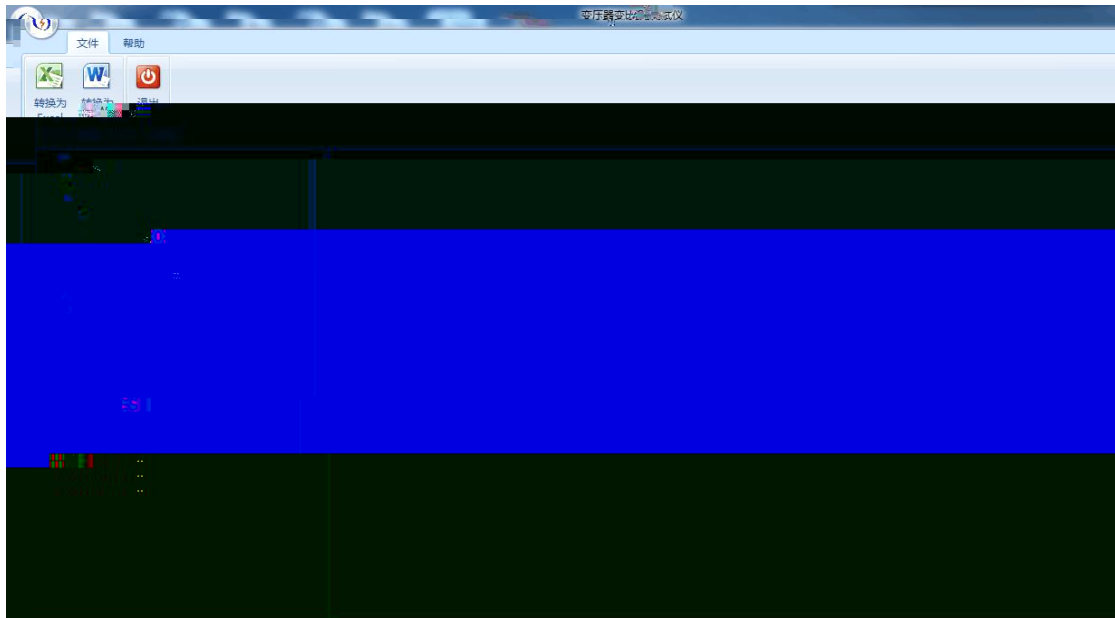

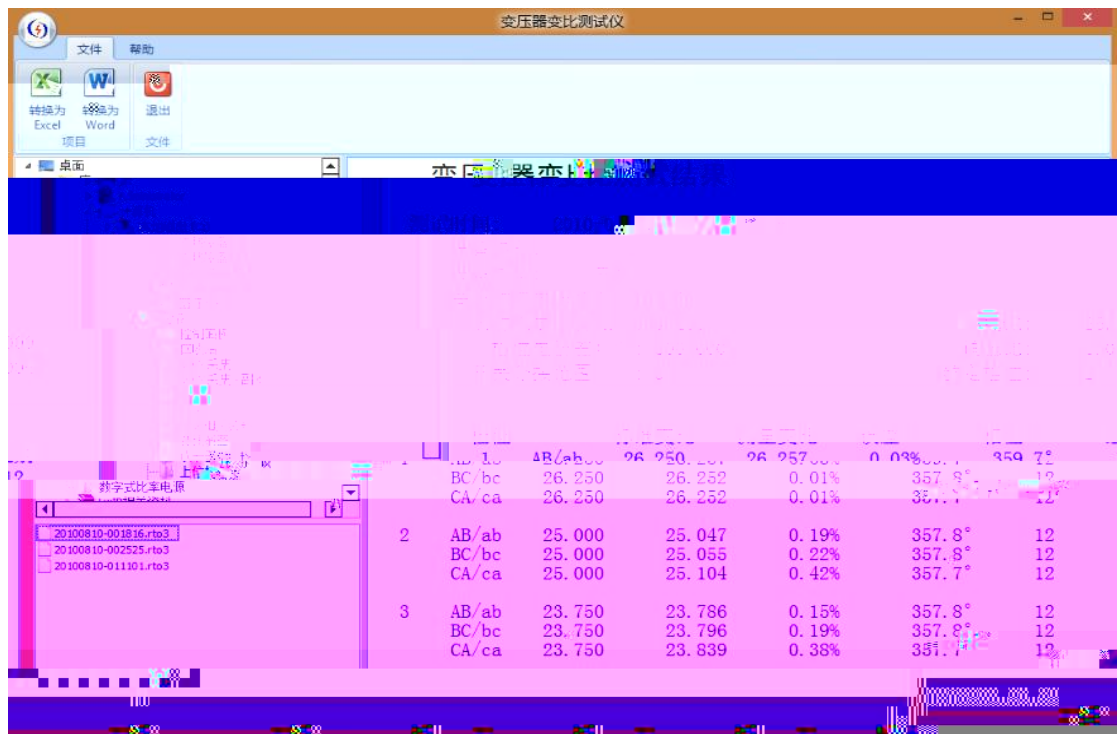

word

2019-03-30 00:14:37

	ABC		
%		%	
(Hz)			

	kV	kV		%			°			
				AB/ab	BC/bc	CA/ca	AB/ab	BC/bc	CA/ca	
1	10.50	0.40	26.25	0.03	0.03	0.07	0.1	0.0	-0.1	12
2	10.00	0.40	25.00	-0.01	0.00	0.03	0.1	0.0	-0.1	12
3	9.50	0.40	23.75	-0.05	-0.04	-0.01	0.1	0.0	-0.1	12

: _____ : _____ : _____

1

2

3

4

5

U